




HBA #UL924BRLN1 & #UL924BRLN2

For Use with LX or CX Relay Panels when transfer to separate Emergency Circuit is required during commercial power failure

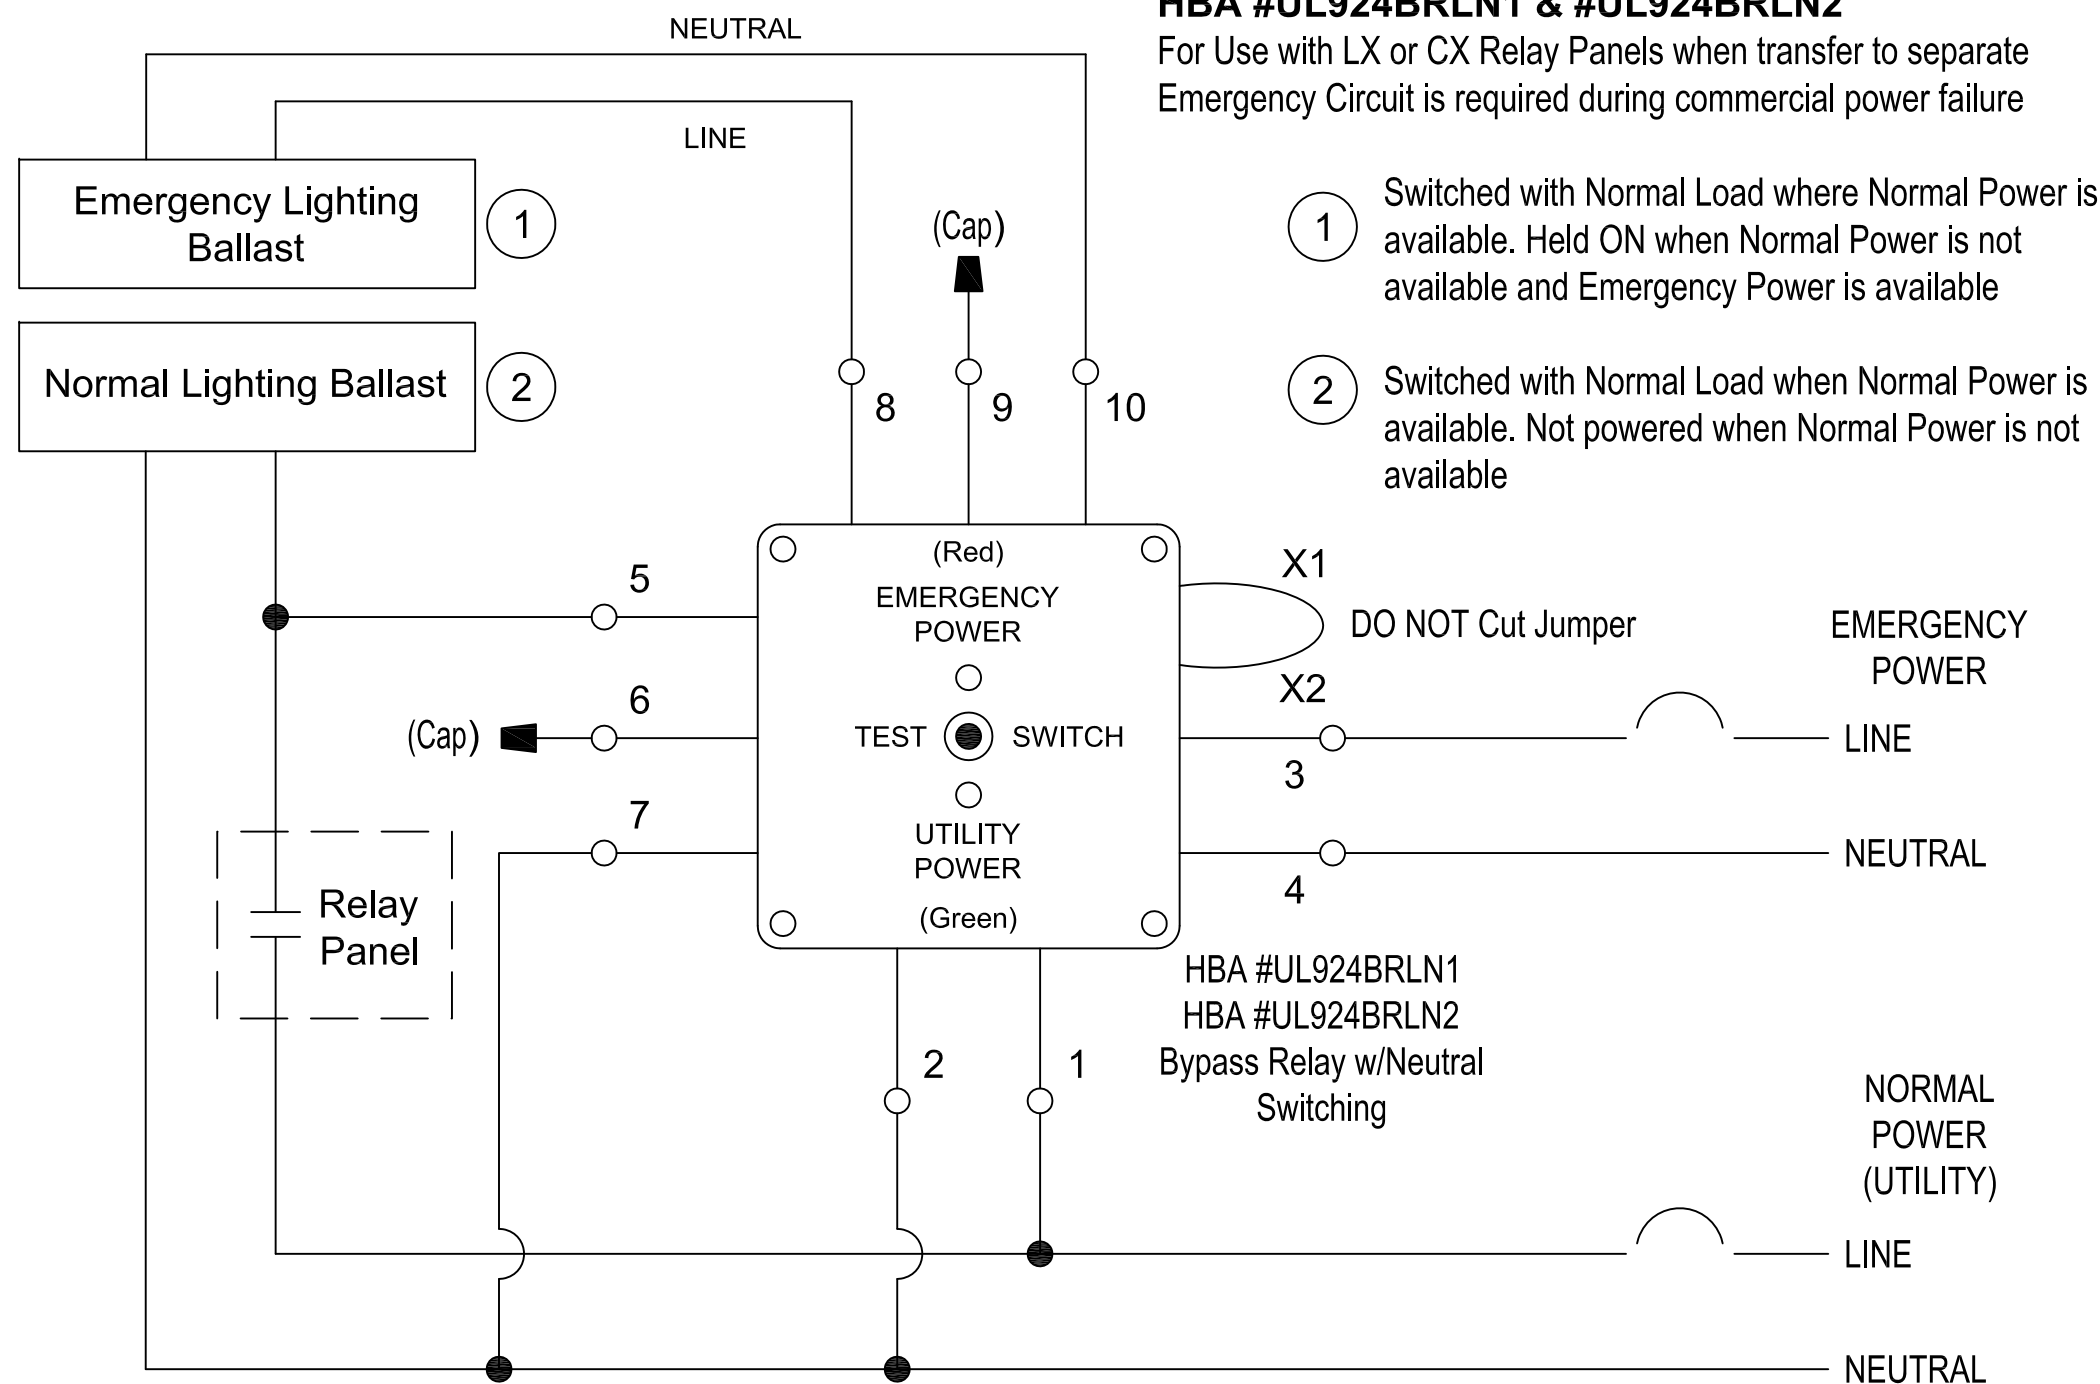

- ① Switched with Normal Load where Normal Power is available. Held ON when Normal Power is not available and Emergency Power is available
- ② Switched with Normal Load when Normal Power is available. Not powered when Normal Power is not available

HBA #UL924BRLN1
HBA #UL924BRLN2
Bypass Relay w/Neutral Switching

REV	REVISION DESCRIPTION	DATE	LX AND CX PANELS WITH UL924BRLN1 OR UL924BRLN2		#UL924BRLN1 & #UL924BRLN2
			ADDRESS STREET CITY, STATE		
			Hubbell Building Automation		
			(888) 698-3242 (512) 450-1100	9601 Dessau Rd. - Bldg 1 Austin, Tx 78745	DETAIL DATE 10-22-12
			THIS DOCUMENT AND SPECIFICATIONS DESCRIBED WITHIN ARE THE EXCLUSIVE PROPERTY OF HUBBELL BUILDING AUTOMATION ISSUED IN THE STRICTEST CONFIDENCE, AND SHALL NOT BE REPRODUCED, COPIED OR USED WITHOUT PRIOR WRITTEN PERMISSION.		1